

Your Reliable Guide for Power Solutions

To fulfill our commitment to be the leading supplier in the Power Generation Industry, the Total Energy Systems, Inc. team ensures they are always up-to-date with the current Power Industry standards as well as industry trends. As a service, our **Information Sheets** are circulated on a regular basis, to existing and potential Power Customers to maintain their awareness of changes and developments in standards, codes and technology within the Power Industry.

Protected Above-Ground Tanks for Flammable and Combustible Liquids

Covered By UL 2085

We note an emerging trend towards UL2085 for above ground generator fuel tanks with secondary containment. Stringent EPA controls on Underground Storage Tanks (UST's), and larger penalties for ground contamination, have led to much greater usage of Above Ground Storage Tanks (AST's). However, once above ground in addition to environmental factors we have to consider the safe use and storage of flammable fuels.

Key safety factors and codes to be considered in fuel tank design are:

- Ability to withstand fire (UL 2085 Section 17)
- Vehicle Impact Resistance (UL 2085 Section 20)
- Projectile Resistance (UL 2085 Section 21)

In addition to UL standards, fuel tanks also have to meet all NFPA Fire Code requirements.

The information in this sheet gives details of the designs Fuel Tank manufacturers are using to meet the dictates of UL 2085, UL142, NFPA 30, 37, and 110, and address the safety factors listed above.

Manufacturers have taken the concept of the UL142 double-walled fuel tanks, and achieved compliance to UL 2085 by a combination of rigid design, stronger carbon steel materials, and insulation between outside and inside containment walls.

These additional features give the fuel tank the ability to:

Withstand fire: With 2-hour liquid pool and furnace fire tests, the primary internal tank sees on average a temperature rise of no more than 260° F

Resist Vehicle Impact: Maintain fuel containment after an impact of 12,000 lbs force @ 10mph

Resist Projectiles : One manufacturer quotes a test with 150-grain, 30-caliber bullet, muzzle velocity 2,700 feet per sec. from 100'.

“See over for illustration of typical UL 2085 fuel tank that meets the above parameters”

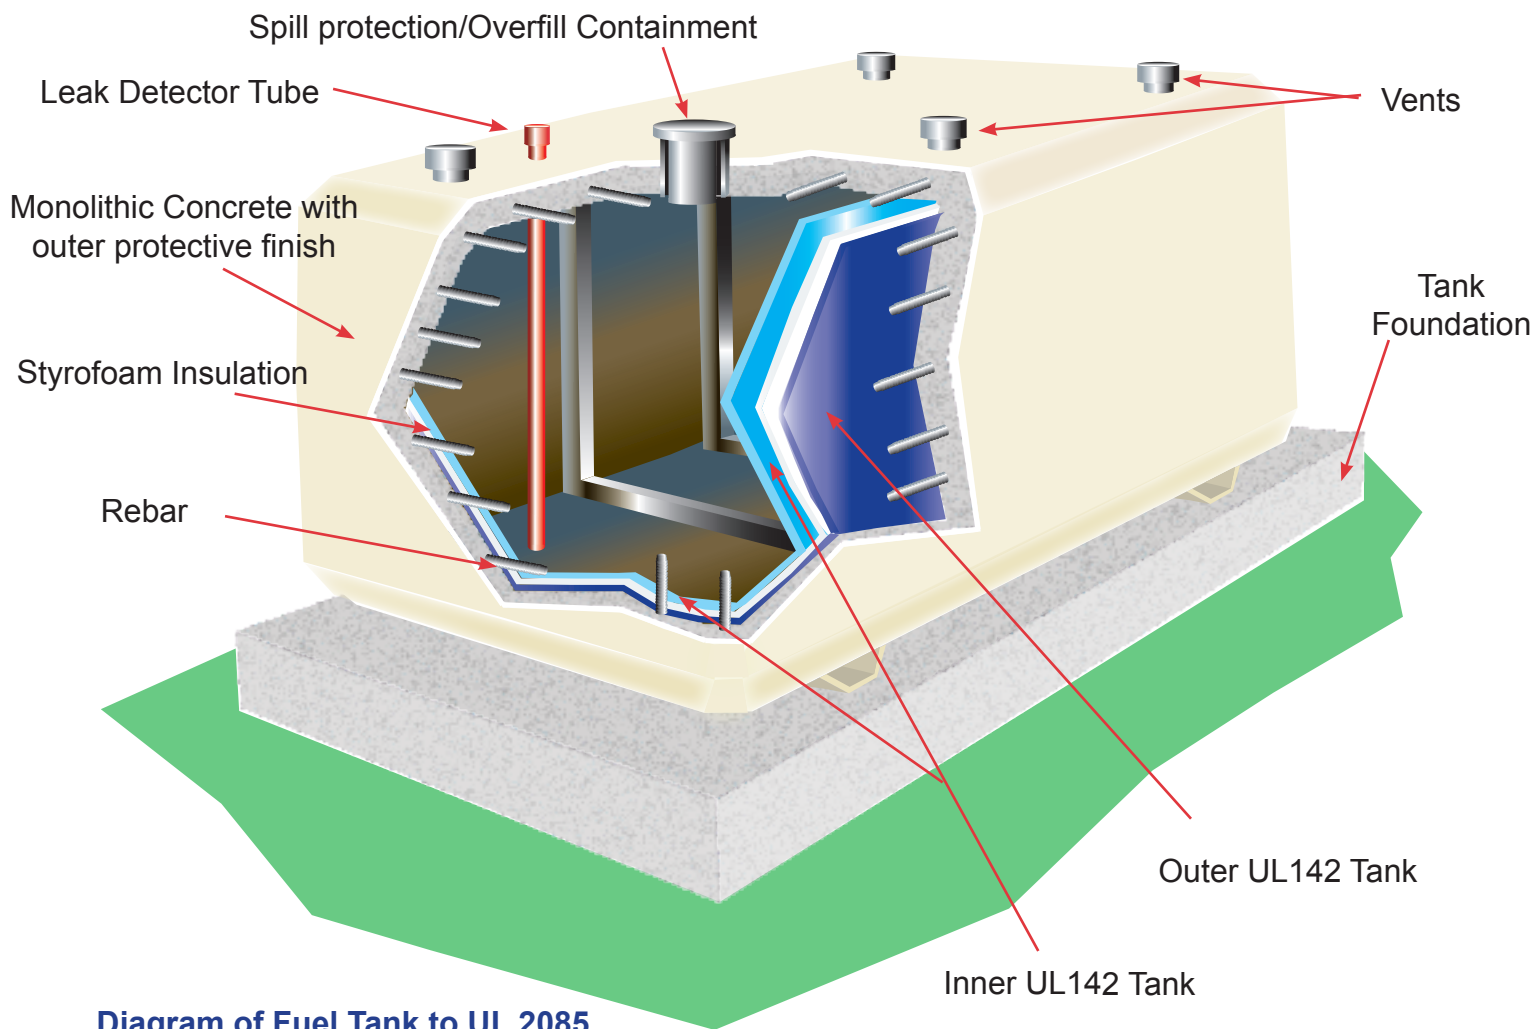


Diagram of Fuel Tank to UL 2085

The illustration above shows a typical design for a “beside installation” vaulted fuel tank. Other forms of vaulted tanks to UL 2085 permit the generator set to be mounted above the tank. Above 500 gallons many Cities specify these tanks and, in most cases, NFPA 37 requires extra precautions above 500 gallons.

Fire departments are demonstrating a keen preference for this type of tank, and we foresee this as the standard tank for the future.

Useful Web-Sites for further information:

Underwriters Laboratory: www.ulstandardsinfontet.ul.com/scopes/2085
 NFPA www.nfpa.org


The Total Energy Systems technical support team will be very happy to discuss specific needs with you, and provide you with further information and details of all available options to satisfy the requirements of UL 2085 and any other questions concerning your power needs.

Total Energy Systems have with full sales and support capabilities with 24-hour local support.



Corporate office
 1400 West Main Avenue
 DePere, WI 54115
 (920) 964-1400
 (888) 548-1400
 (920) 964-1409 (fax)

Milwaukee Branch
 8525 N. 87th St.
 Milwaukee, WI 53224
 (414) 357-7900
 (800) 236-6626
 (414) 357-6278 (fax)



Total Energy Systems, LLC